


**SOUTH LOUISIANA COOPERATIVE ASSOCIATION
METER INSTALLATION SPECIFICATIONS
MOBILE HOME OR TEMPORARY SERVICES
(SINGLE PHASE - 120/240 VOLT)**

NOTES:

1. ALL SERVICE SPECIFICATIONS HEREIN SHALL BE INSTALLED PER NATIONAL ELECTRICAL CODE (NEC).
2. **"SLECA SHOULD BE CONTACTED BEFORE ESTABLISHING A METER ENTRANCE LOCATION."**
3. CUSTOMER TO FURNISH AND INSTALL ALL MATERIALS UNLESS STATED OTHERWISE.
4. PARISH PERMITS ARE REQUIRED FOR NEW SERVICES.
5. **METER PAN, BREAKER PANEL COMBOS (GANGPAN METERS) NOT ALLOWED. BREAKER PANEL MUST BE SEPERATE FROM METER.**
6. Property owners are responsible for marking and notifying SLECA of any private utilities such as sewer lines, etc. prior to SLECA digging or trenching on their property. Damage to private utilities that are not marked or have not been identified by the property owner to SLECA due to digging or trenching is the responsibility of the property owner. SLECA is not liable for these damages.

REVISED 8/24/09

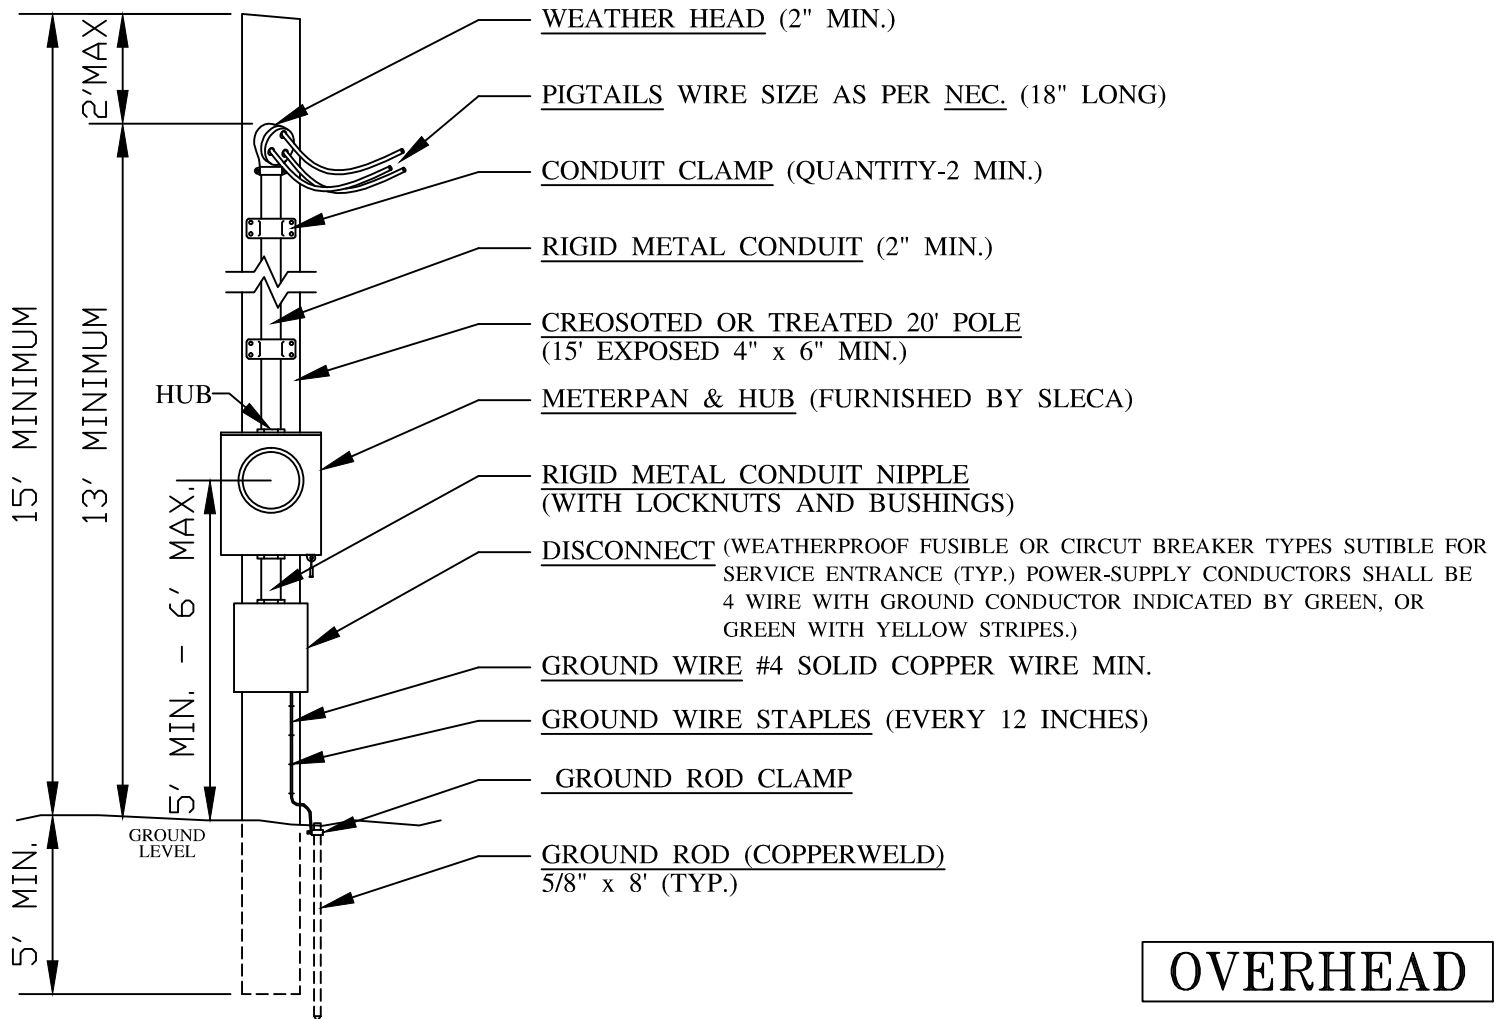

NOTE: TEMPORARY SERVICE

CUSTOMER IS REQUIRED TO INSTALL METER ENTRANCE WITHIN 10' OF SLECA'S PEDESTAL OR TRANSFORMER AND IS REQUIRED TO FURNISH CONDUCTOR. SLECA WILL CONNECT CONDUCTOR TO PEDESTAL OR TRANSFORMER.

