


PERMANENT OVERHEAD SERVICE TO HOUSE (ABOVE ROOFLINE)

SOUTH LOUISIANA ELECTRIC COOPERATIVE ASSOCIATION METER INSTALLATION SPECIFICATIONS (SINGLE PHASE - 120/240 VOLT)

NOTES:

1. ALL SERVICE SPECIFICATIONS HEREIN SHALL BE INSTALLED PER NATIONAL ELECTRICAL CODE (NEC).
2. "CONTACT SLECA BEFORE ESTABLISHING A METER ENTRANCE LOCATION."
3. CUSTOMER TO FURNISH AND INSTALL ALL MATERIALS UNLESS STATED OTHERWISE.
4. PARISH PERMITS ARE REQUIRED FOR NEW SERVICES.
5. Property owners are responsible for marking and notifying SLECA of any private utilities such as sewer lines, etc. prior to SLECA digging or trenching on their property. Damage to private utilities that are not marked or have not been identified by the property owner to SLECA due to digging or trenching is the responsibility of the property owner. SLECA is not liable for these damages.
6. The 18" minimum is allowed only when the service mast is within 4' of the edge of the roof and no more than 6' of conductors pass over the roof. (Per NEC 230.24A)
7. Conduit Outlets "LB's" are not allowed anywhere on conduit that attaches to meterpan.

All conductors that are provided by customer shall be copper and sized as per NEC Codes or as specified below.

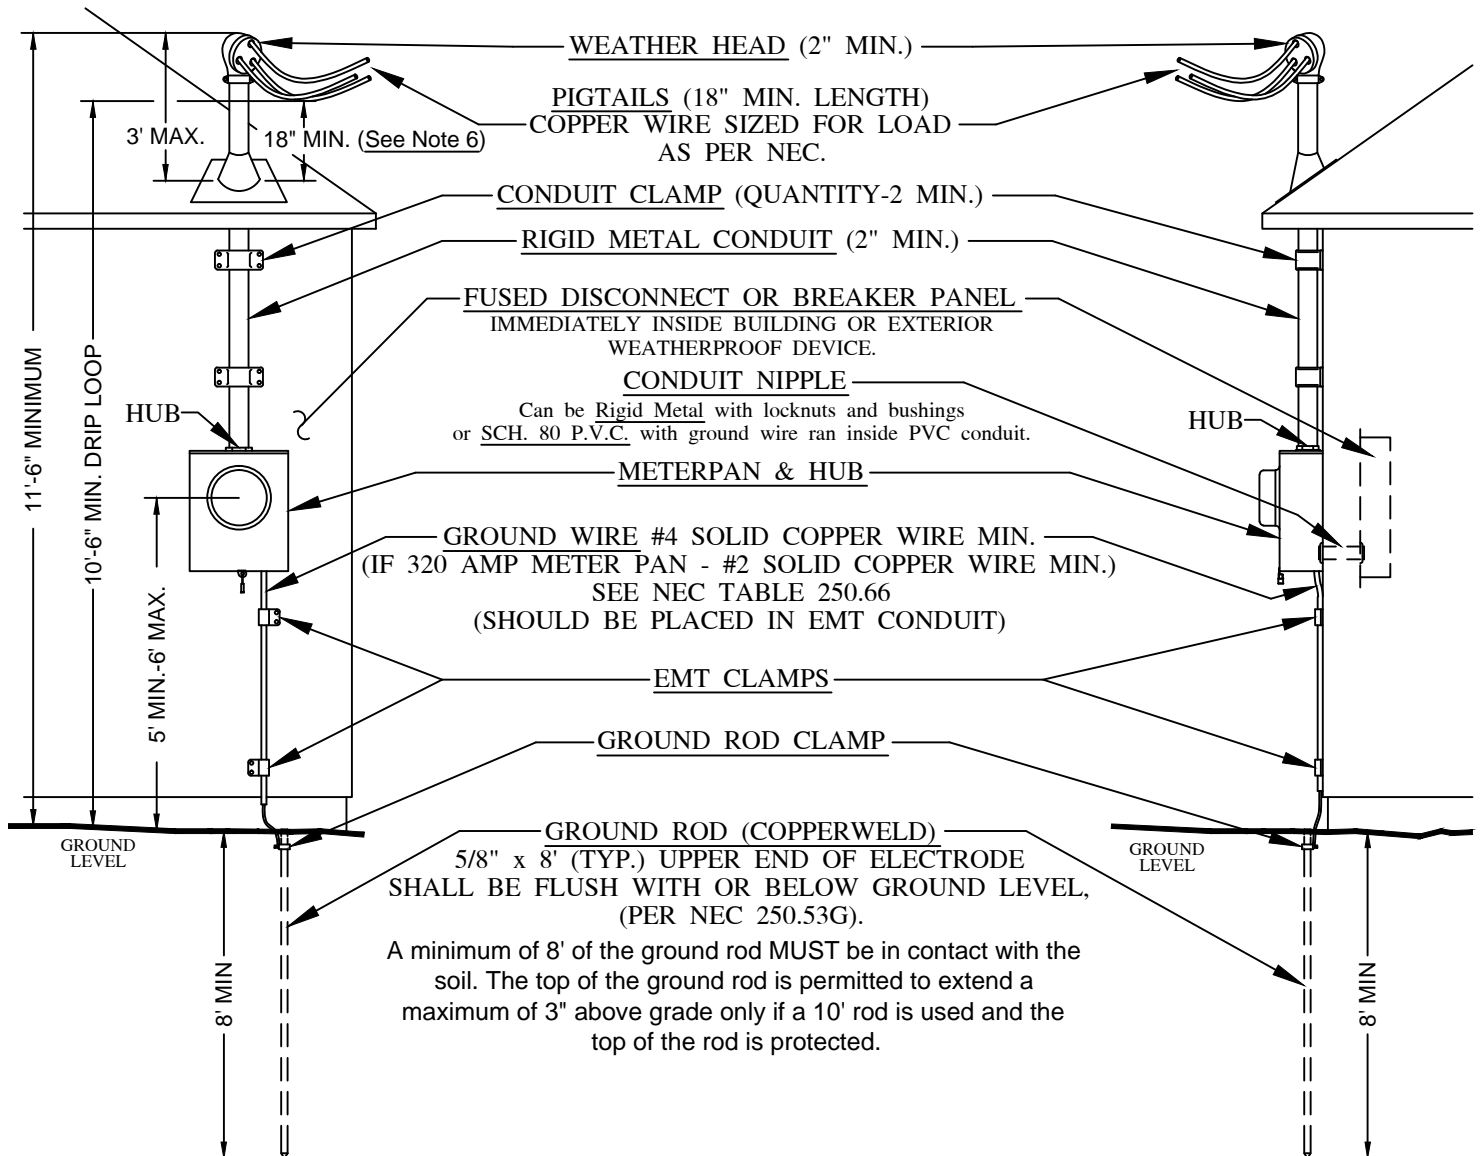

This drawing depicts a typical installation. If the customer's proposed service installation will be located within 3' of a window, door, porch, balcony, ladder, stairs, fire escape or similar location, CONTACT SLECA.